

February 23, 2026

***VIA ELECTRONIC FILING***

Docket # 2025 NON

Patrick Doherty  
Program Manager  
Compliance Assurance Division  
Office of Energy Infrastructure Safety  
715 P Street, 20th Floor  
Sacramento, CA 95814  
[Patrick.Doherty@energysafety.ca.gov](mailto:Patrick.Doherty@energysafety.ca.gov)

**RE: PacifiCorp's Response to Notice of Non-Performance –  
PAD\_PC\_RMA\_20251007\_1132**

Dear Patrick Doherty:

PacifiCorp provides the following response to the finding identified in the “Notice of Non-Performance, “*NON\_PAD\_PC\_RMA\_20251007\_1132*” (NON) issued by the Office of Energy Infrastructure Safety (Energy Safety) on January 23, 2026. On October 7, 2025, Energy Safety conducted an inspection of PacifiCorp's WMP initiatives in the vicinity of the city of Yreka, California.

Energy Safety found the following deficiency:


**Deficiency 1.** Energy Safety observed that in implementing the 2025 WMP initiative 8.1.2.12 – Expulsion Fuse Replacements, PC failed to complete the installation of CAL FIRE-approved non-expulsion fuses on Pole ID 624507.367802, Grid Hardening ID 7112939 at coordinates 41.71141544174789, -122.598414. Energy Safety considers this non-performance to be in the Minor risk category. PC must complete corrective action for this deficiency by 12 months of this notice.

**PacifiCorp Response:**

In response to the notice of non-performance, the company conducted a field inspection on February 16, 2026, and confirmed the presence of a non-expulsion fuse missing its red end cap. The company will replace the fuse to address this deficiency.

5G149. 6245007.0367802

No solid blade fuses installed at this location.

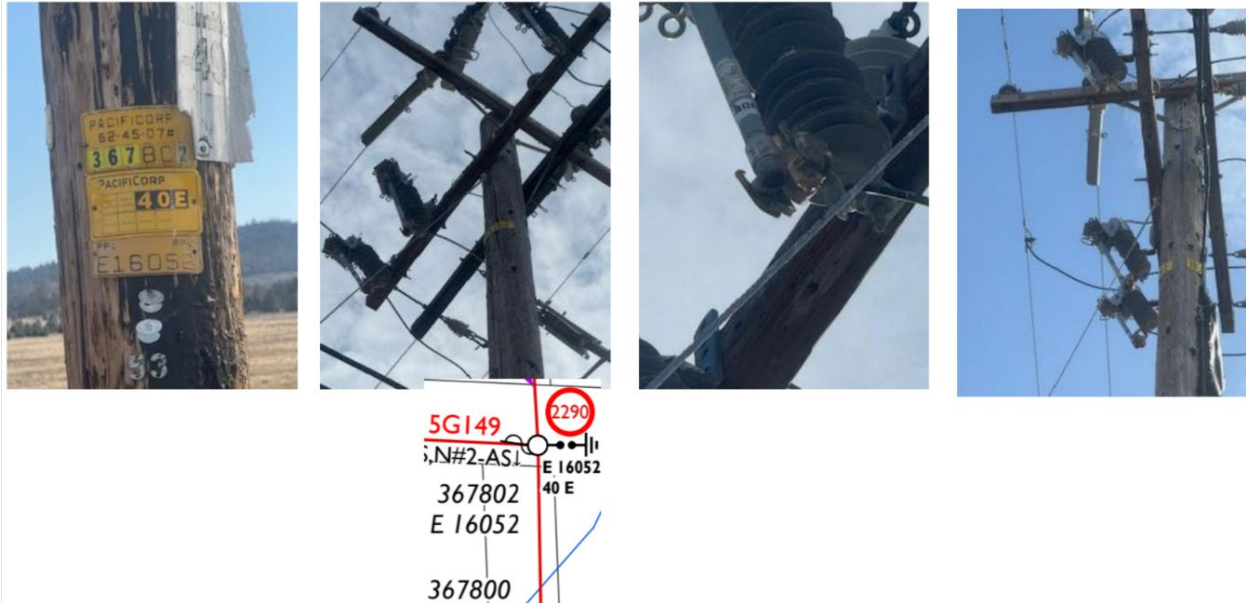

**Picture 1: Near Pole ID 624507.367802, Grid Hardening ID 7112939 at coordinates 41.71141544174789, -122.598414. Picture taken February 16, 2026.**

PacifiCorp appreciates the opportunity to provide this response to Energy Safety's NON\_PAD\_PC\_RMA\_20251007\_1132.

Please refer any questions to Pooja Kishore, Regulatory Affairs Manager at 503-813-7314 or via email at [pooja.kishore@pacificorp.com](mailto:pooja.kishore@pacificorp.com) and [californiadockets@pacificorp.com](mailto:californiadockets@pacificorp.com).

Sincerely,

*Carrie Laird*

Carrie Laird  
Vice President, Wildfire Mitigation and Emergency Operations

cc: [assetperformance@energysafety.ca.gov](mailto:assetperformance@energysafety.ca.gov)  
[Shannon.Greene@energysafety.ca.gov](mailto:Shannon.Greene@energysafety.ca.gov)  
[Yana.Loginova@energysafety.ca.gov](mailto:Yana.Loginova@energysafety.ca.gov)  
[Babak.Kaviani@energysafety.ca.gov](mailto:Babak.Kaviani@energysafety.ca.gov)  
[Samuel.Isaiah@energysafety.ca.gov](mailto:Samuel.Isaiah@energysafety.ca.gov)  
[Ivan.Garcia@energysafety.ca.gov](mailto:Ivan.Garcia@energysafety.ca.gov)  
[Patrick.Doherty@energysafety.ca.gov](mailto:Patrick.Doherty@energysafety.ca.gov)