

February 23, 2026

VIA ELECTRONIC FILING

Docket # 2025 NON

Patrick Doherty
Program Manager
Compliance Assurance Division
Office of Energy Infrastructure Safety
715 P Street, 20th Floor
Sacramento, CA 95814
Patrick.Doherty@energysafety.ca.gov

RE: PacifiCorp's Response to Notice of Non-Performance - PAD_PC_IAG_20251007_1142

Dear Patrick Doherty:

PacifiCorp provides the following response to the finding identified in the "Notice of Non-Performance, "*NON_PAD_PC_IAG_20251007_1142*" (NON) issued by the Office of Energy Infrastructure Safety (Energy Safety) on January 23, 2026. On October 7, 2025, Energy Safety conducted an inspection of PacifiCorp's WMP initiatives in the vicinity of the city of Montague, California.

Energy Safety found the following deficiency:


Deficiency 1. Energy Safety observed that in implementing 2025 WMP initiative 8.1.2.12-Expulsion Fuse Replacements, PC failed to complete the installation of CAL FIRE-approved non expulsion fuses on Pole ID 624506.332400, associated with Grid Hardening ID 7112939 at coordinates 41.70484664234158, -122.54966794542612. Energy Safety considers this non-performance to be in the Minor risk category. PC must complete a corrective action for this deficiency by 12 months from the date of this notice.

PacifiCorp Response:

In response to the Notice of Non-Performance, the company conducted a field inspection on January 29, 2026, and verified that one phase is currently deenergized. As a result, installation of a non expulsion fuse on this phase is not required at this time. The cutout has been properly installed, and the appropriate non expulsion fuse is already attached to the pole and available for installation should the phase be energized in the future.

5G149. 06245006.0332400

One phase is de-energized. Fuse hanging on pole is non-expulsion fuse.

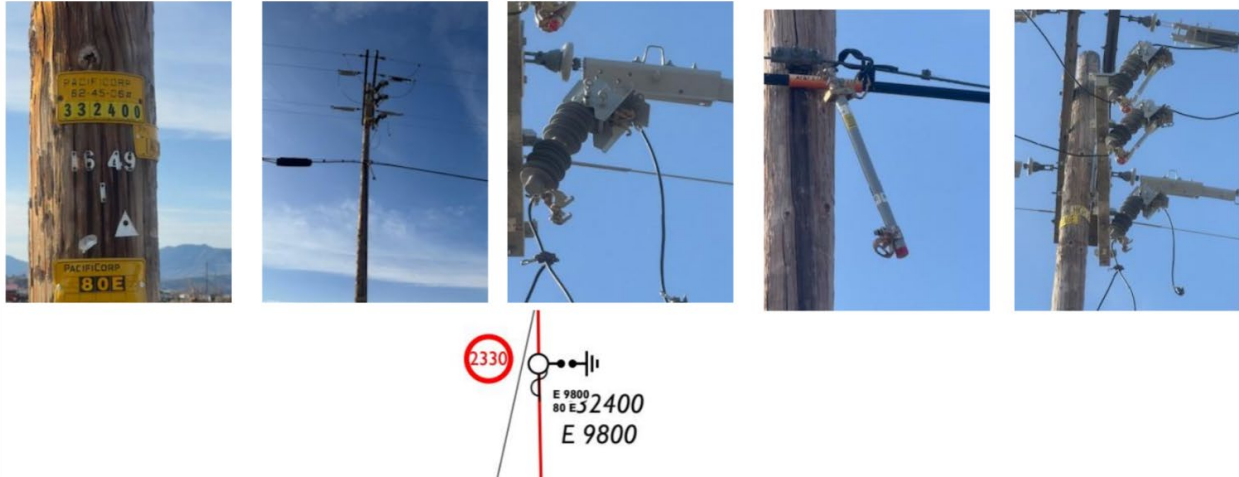

Picture 1: Pole ID 624506.332400, associated with Grid Hardening ID 7112939 at coordinates 41.70484664234158, -122.54966794542612. Picture taken January 29, 2026.

PacifiCorp appreciates the opportunity to provide this response to Energy Safety's NON_PAD_PC_IAG_20251007_1142.

Please refer any questions to Pooja Kishore, Regulatory Affairs Manager at 503-813-7314 or via email at pooja.kishore@pacificorp.com and californiadockets@pacificorp.com.

Sincerely,

Carrie Laird

Carrie Laird
Vice President, Wildfire Mitigation and Emergency Operations

cc: assetperformance@energysafety.ca.gov
Shannon.Greene@energysafety.ca.gov
Yana.Loginova@energysafety.ca.gov
Babak.Kaviani@energysafety.ca.gov
Samuel.Isaiah@energysafety.ca.gov
Ivan.Garcia@energysafety.ca.gov
Patrick.Doherty@energysafety.ca.gov