

March 5, 2026

***VIA ELECTRONIC FILING***

Docket # 2025 NON

Patrick Doherty  
Program Manager  
Compliance Assurance Division  
Office of Energy Infrastructure Safety  
715 P Street, 20th Floor  
Sacramento, CA 95814  
[Patrick.Doherty@energysafety.ca.gov](mailto:Patrick.Doherty@energysafety.ca.gov)

**RE: PacifiCorp's Response to Notice of Non-Performance –  
PAD\_PC\_CYA\_20251007\_0930**

Dear Patrick Doherty:

PacifiCorp provides the following response to the finding identified in the “Notice of Non-Performance, “NON\_PAD\_PC\_CYA\_20251007\_0930” (NON) issued by the Office of Energy Infrastructure Safety (Energy Safety) on February 3, 2026. On October 7, 2025, Energy Safety conducted an inspection of PacifiCorp’s WMP initiatives in the vicinity of the city of Yreka, California.

Energy Safety found the following deficiency:

**Deficiency 1.** Energy Safety observed that in implementing 2025 WMP initiative 8.1.2.12 - Expulsion Fuse Replacements, PC failed to complete the installation of CAL FIRE-approved non expulsion fuses on Pole ID 06245007.0275104, Grid Hardening ID 7074439 at coordinates 41.71645204223936, -122.6414627790075. Energy Safety considers this non-performance to be in the Minor risk category. PC must complete a corrective action for this deficiency by 12 months from this date of notice.


**PacifiCorp Response:**

In response to the Notice of Non-Performance, the company conducted a field inspection on February 5, 2026. No corrective actions were required. Solid blades were previously installed at this location. Although Pacific Power reported these installations as complete in 2024, CAL FIRE has not yet updated its standards to classify solid blades as non-exempt for line fuses. As a result, Pacific Power has discontinued counting similar installations as completed units; however, the solid blades already installed will remain in place.

5G5 Greenhorn

06245007.0275104

1532 S OREGON ST, Yreka

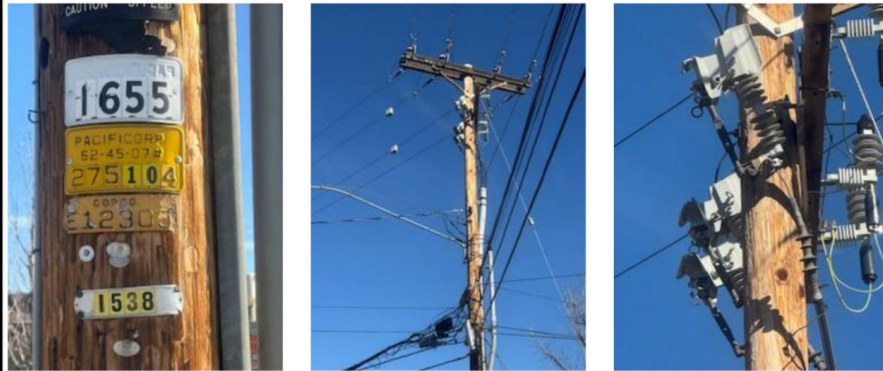


**Picture 1: Near Pole ID 06245007.0275104, Grid Hardening ID 7074439 at coordinates 41.71645204223936, -122.6414627790075. Picture taken February 5, 2026.**

5G5 Greenhorn

06245007.0275104

1532 S OREGON ST, Yreka

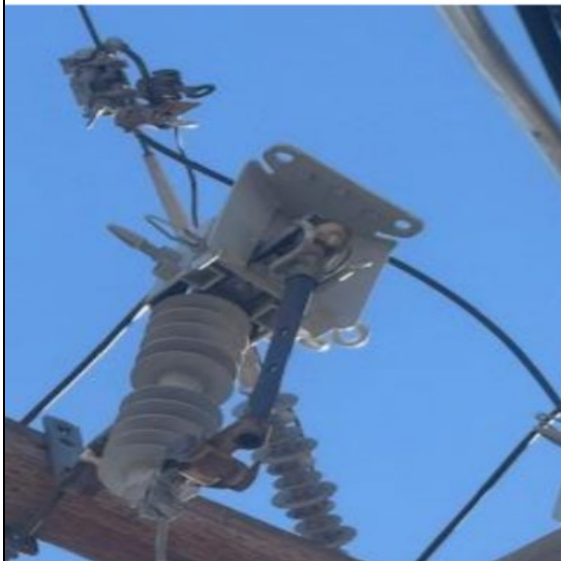

**Picture 2: Near Pole ID 06245007.0275104, Grid Hardening ID 7074439 at coordinates 41.71645204223936, -122.6414627790075. Picture taken February 5, 2026.**

Office of Energy Infrastructure Safety


March 5, 2026

Page 3

PacifiCorp appreciates the opportunity to provide this response to Energy Safety's NON\_PAD\_PC\_CYA\_20251007\_0930.

Please refer any questions to Pooja Kishore, Regulatory Affairs Manager at 503-813-7314 or via email at [pooja.kishore@pacificorp.com](mailto:pooja.kishore@pacificorp.com) and [californiadockets@pacificorp.com](mailto:californiadockets@pacificorp.com).

Sincerely,



Carrie Laird

Vice President, Wildfire Mitigation and Emergency Operations

cc: [assetperformance@energysafety.ca.gov](mailto:assetperformance@energysafety.ca.gov)  
[Shannon.Greene@energysafety.ca.gov](mailto:Shannon.Greene@energysafety.ca.gov)  
[Yana.Loginova@energysafety.ca.gov](mailto:Yana.Loginova@energysafety.ca.gov)  
[Babak.Kaviani@energysafety.ca.gov](mailto:Babak.Kaviani@energysafety.ca.gov)  
[Samuel.Isaiah@energysafety.ca.gov](mailto:Samuel.Isaiah@energysafety.ca.gov)  
[Ivan.Garcia@energysafety.ca.gov](mailto:Ivan.Garcia@energysafety.ca.gov)  
[Patrick.Doherty@energysafety.ca.gov](mailto:Patrick.Doherty@energysafety.ca.gov)