



March 30, 2026

VIA ELECTRONIC FILING

Docket # 2025 NODI

Patrick Doherty
Program Manager
Compliance Assurance Division
Office of Energy Infrastructure Safety
715 P Street, 20th Floor
Sacramento, CA 95814
Patrick.Doherty@energysafety.ca.gov

RE: PacifiCorp’s Response to Notice of Data Inaccuracy – PAD_PC_BKA_20251008_1411

Dear Patrick Doherty:

PacifiCorp provides the following response to the finding identified in the “Notice of Data Inaccuracy, “NODI_PAD_PC_BKA_20251008_1411” (NODI) issued by the Office of Energy Infrastructure Safety (Energy Safety) on February 26, 2026. On October 8, 2025, Energy Safety conducted an inspection of PacifiCorp’s WMP initiatives in the vicinity of the city of Weed, California.

Energy Safety found the following data inaccuracy:

Data Inaccuracy 1. On Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788, the inspector observed that PC failed to adhere to data accuracy.

PacifiCorp Response:

In response to the Notice of Data Inaccuracy, the company conducted a field inspection on March 6, 2026. This pole takes all uncovered conductors underground. Riser is complete, and underground vaults are installed. PacifiCorp reported that this asset is underground (Field Name “AssetOHUG”) in the company’s 2025 second quarter Quarterly Data Report as shown in the excerpt below, not that covered conductor installation had been completed, but recognize there may have been confusion between the information in this field and the “DescriptionOfWork” field.

project	GhID	AssetOHUG	DescriptionOfWork	FieldNotes	GhStatus
Old Edgewood and Lincoln Park Pt.01	8077661h	Overhead	Reconductor with Covered Conductor		Complete


Figure 1: Excerpt from the Second Quarter Quarterly Data Report



Pictures 1-2: Near Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788. Picture taken March 6, 2026.



Pictures 3-4: Near Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788. Picture taken March 6, 2026.

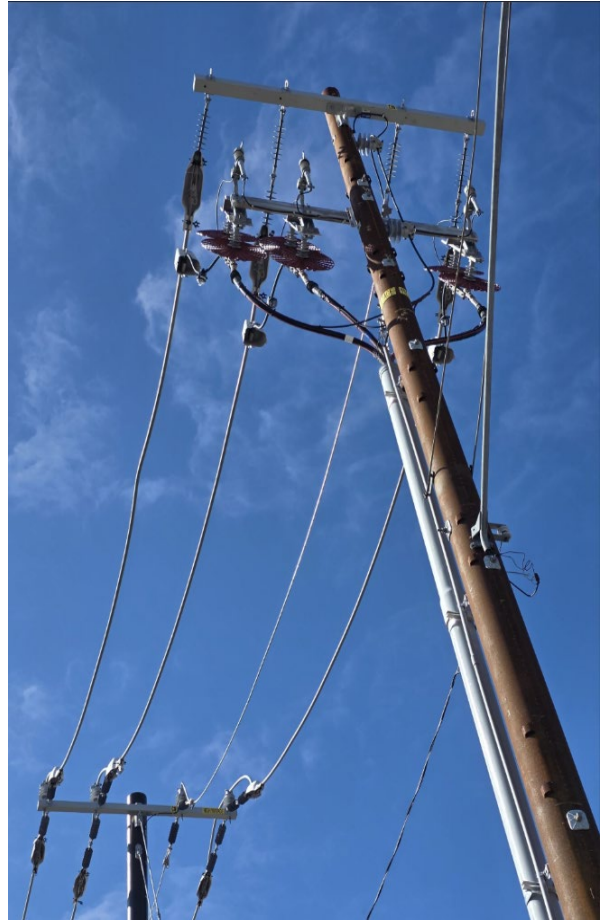

Picture 5-6: Near Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788. Picture taken March 6, 2026.



Picture 7-8: Near Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788. Picture taken March 6, 2026.



Picture 9: Near Pole ID 06241005.026600, Grid Hardening ID 8077661h at coordinates 41.4305141166174, -122.388788. Picture taken March 6, 2026.

PacifiCorp appreciates the opportunity to provide this response to Energy Safety's NODI_PAD_PC_BKA_20251008_1411.

Please refer any questions to Pooja Kishore, Regulatory Affairs Manager at 503-813-7314 or via email at pooja.kishore@pacificorp.com and californiadockets@pacificorp.com.

Sincerely,

Carrie Laird

Carrie Laird
Vice President, Wildfire Mitigation and Emergency Operations

Cc: assetperformance@energysafety.ca.gov
Shannon.Greene@energysafety.ca.gov
Babak.Kaviani@energysafety.ca.gov
Samuel.Isaiah@energysafety.ca.gov